
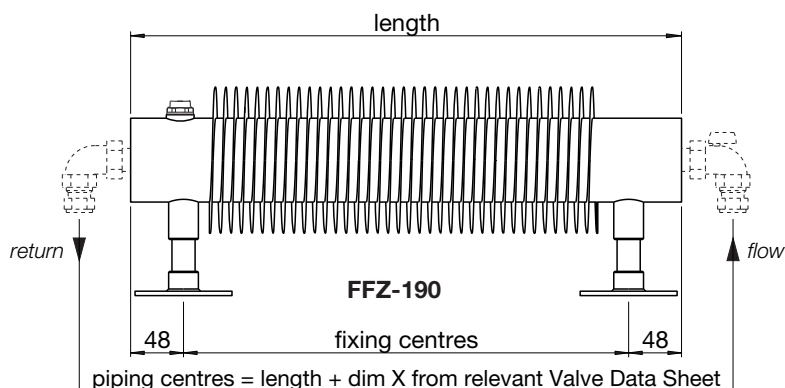
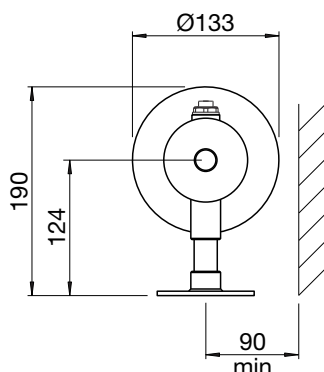
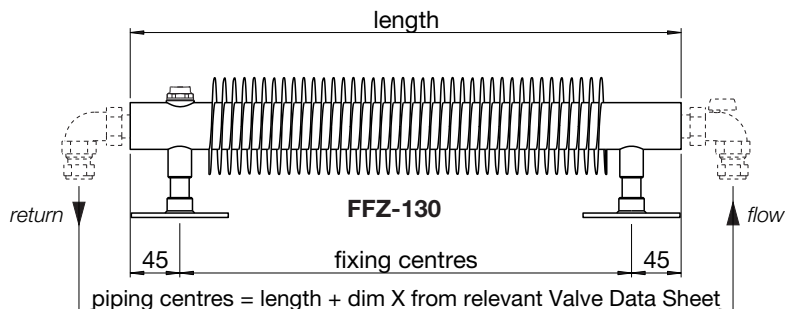


Zehnder Flow Form

always the
best climate

zehnder



All dimensions shown are in millimetres

Test pressure: **16.9 BAR**

Max working pressure: **10 BAR**

Max working temperature: **95° C**


All steel construction

Connections: **½ inch BSP opposite end tapings**

This radiator may only be installed horizontally on floor

Heat output determined in accordance with EN 442

Test Laboratory: 1428WSP

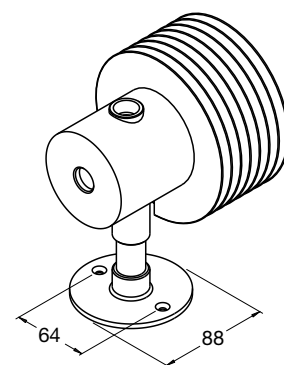

Mounting Foot Detail

Model	Height ± 2mm	Width ± 2mm	Finish	Output ΔT=50K		Output ΔT=30K		n	Weight kg	Water Content litres
				Watts	Btu	Watts	Btu			
FFZ-130-100	130	1000	painted	246	839	132	450	1.22	5.6	1.2
FFZ-130-150	130	1500	painted	361	1232	192	655	1.23	8.3	1.7
FFZ-130-200	130	2000	painted	498	1699	263	897	1.25	11.3	2.2
FFZI-130-100	130	1000	st stl brushed	163	556	87	297	1.23	5.6	1.2
FFZI-130-150	130	1500	st stl brushed	240	819	129	440	1.22	8.3	1.7
FFZI-130-200	130	2000	st stl brushed	316	1078	170	580	1.21	11.3	2.2
FFZ-190-100	190	1000	painted	370	1262	198	676	1.22	10.3	3.7
FFZ-190-150	190	1500	painted	565	1928	299	1020	1.24	15.5	5.6
FFZ-190-200	190	2000	painted	797	2719	423	1443	1.24	20.7	7.5
FFZC-190-100	190	1000	chrome	346	1181	183	624	1.25	10.3	3.7
FFZC-190-150	190	1500	chrome	513	1750	270	921	1.26	15.5	5.6
FFZC-190-200	190	2000	chrome	706	2443	371	1266	1.26	20.7	7.5
FFZI-190-100	190	1000	st stl brushed	222	757	118	403	1.24	10.3	3.7
FFZI-190-150	190	1500	st stl brushed	340	1160	182	621	1.22	15.5	5.6
FFZI-190-200	190	2000	st stl brushed	464	1583	250	853	1.21	20.7	7.5

Issue 1.0



Zehnder Group UK Ltd

Concept House
Watchmoor Point
Camberley
Surrey GU15 3AD

Tel: 01276 605800
Fax: 01276 24058
retailsales@zehnder.co.uk
www.zehnder.co.uk

Registered in England: 2296696

Zehnder Flow Form

always the
best climate

zehnder

Tools & Material Required

Screws - 4mm diameter x 60mm length
Suitable valves
PTFE tape
Silicone thread sealant
Tape measure
Allen key - 13mm & 12mm (when installing Zehnder valves)
Spanner - 17mm
Screwdriver
Electric drill
Masonry drill bit

Key	Component	Qty
A	Air Vent - 1/2"	1
B	Screw, 4mm dia x 60mm*	6
C	Air Vent Key	1

* Screws not supplied

Assembly Instructions

*Sufficient PTFE tape must be applied to valve-tail threads prior to their installation.
Silicone thread sealant should be applied to all threaded components manufactured with 'O-rings'.*

Fit valve tails, using correct size Allen key.

Fit air vent (A).


Accurately mark out holes for mounting feet on floor to dimensions as shown on Technical Data Sheet.

Drill four holes to suit screws (B).

Fix radiator to floor with screws (B).

Plumb radiator to heating circuit with flow opposite air vent.

This radiator should be installed onto a central heating system that has been cleaned/flushed and contains water treatment and inhibitors in accordance with BS7593.

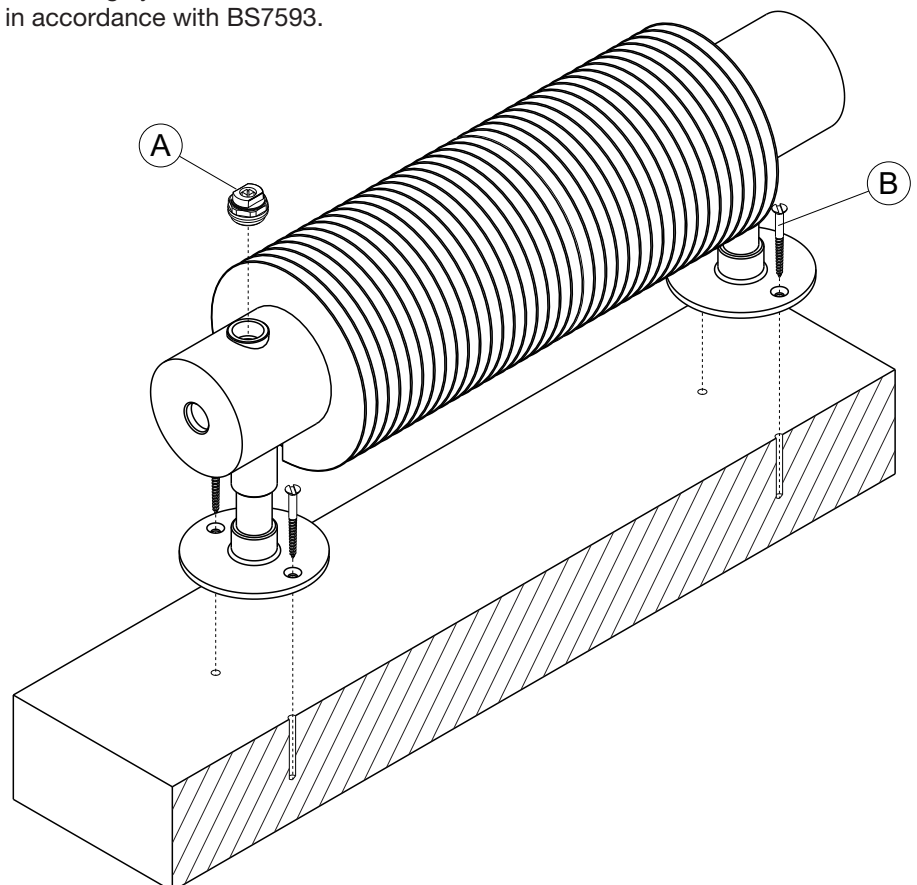

Issue 1.0



Zehnder Group UK Ltd

Concept House
Watchmoor Point
Camberley
Surrey GU15 3AD

Tel: 01276 605800
Fax: 01276 24058
retailsales@zehnder.co.uk
www.zehnder.co.uk

Registered in England: 2296696